

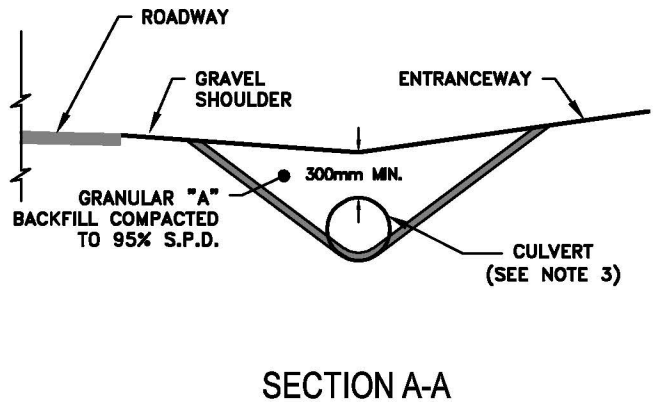


ENTRANCES TYPE	MAX. WIDTH	MIN. ENTRANCE RADIUS
RESIDENTIAL ENTRANCE	7m	5m
SEMI-DETACHED ENTRANCE	6m	5m
COMMERCIAL ENTRANCE	9m	9m
AGRICULTURE ENTRANCE	12m	12m
FIELD ENTRANCE	27m	12m

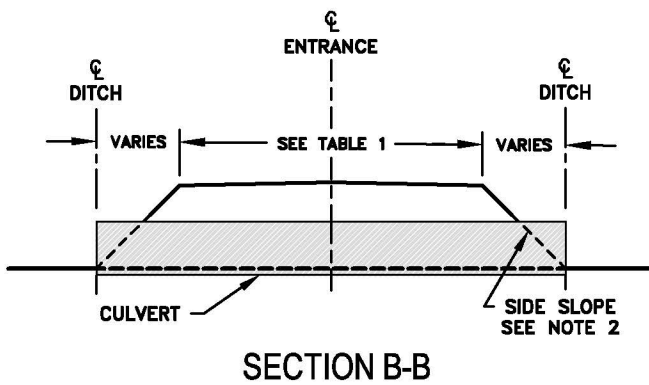

**GENERAL NOTES:**

1. REFER TO OPSD 350.010 & 351.010 FOR ENTRANCES IN URBAN AREAS WITHOUT ROADSIDE DITCHES.
2. SIDE SLOPES AT CULVERT SHALL BE NO STEEPER THAN 2H:1V.
3. THE CULVERT SHALL BE INSTALLED 150mm BELOW THE EXISTING BOTTOM OF DITCH ELEVATION.
4. THE MAXIMUM ENTRANCE GRADIENT IS 6% FOR RESIDENTIAL ENTRANCES AND 10% FOR FARM AND FIELD ENTRANCES.
5. THE ENTRANCEWAY CONSTRUCTION MUST BE COMPLETED WITHIN THE TIMEFRAME IDENTIFIED ON THE PERMIT. THE ENTRANCEWAY CONSTRUCTION WILL BE SUBSTANTIALLY COMPLETED WHEN THE SURFACE OF THE ENTRANCEWAY IS COVERED WITH A MINIMUM GRANULAR "A" THICKNESS OF 150mm.
6. PRIOR TO CONSTRUCTION, THE COUNTY'S PUBLIC WORKS FOREMAN WILL INSPECT THE PROPOSED ENTRANCE LOCATION AND DETERMINE THE SIZE, LENGTH AND LOCATION OF THE CULVERT. THE PROPERTY OWNER SHALL INDICATE WITH TWO (2) PAINTED WOODEN STAKES THE EXACT LOCATION OF THE PROPOSED CULVERT. THE OWNER IS RESPONSIBLE FOR ALL COSTS ASSOCIATED WITH THE PURCHASE AND INSTALLATION OF THE CULVERT, AS REQUIRED.
7. THE DITCH MUST BE CLEANED AND SLOPED PROPERLY BEFORE ANY PIPE IS INSTALLED.
8. THE OWNER MUST MAKE ARRANGEMENTS WITH UTILITY COMPANIES AND PUBLIC SERVICES TO DETERMINE THE LOCATION OF ANY BURIED SERVICES AND SHALL BE RESPONSIBLE FOR ANY DAMAGES.

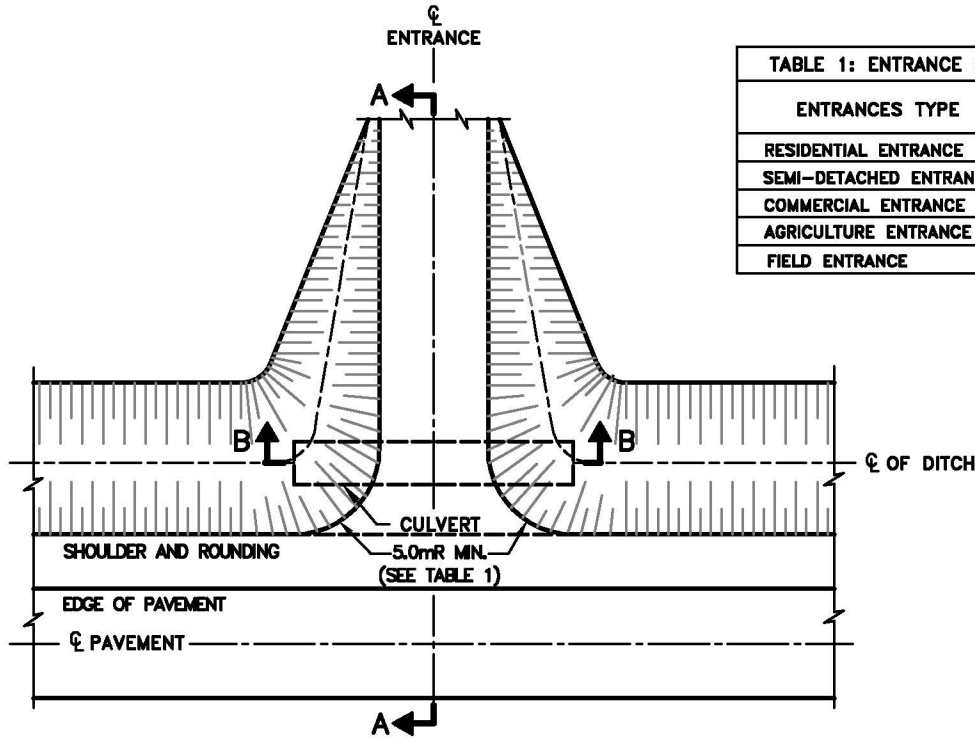

**ENTRANCE DRAWING**

APPROVED BY:  
 Pier-Luc Mainville  
 Public Works Engineer

---

DATE: October 2021

---

DWG. No.:  
**UCPR ENT-01-EN**